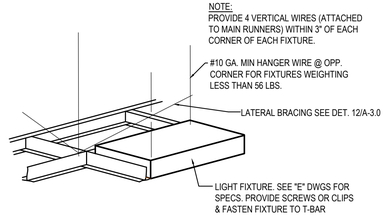

LIGHT FIXTURE DETAIL 4

NOT TO SCALE E-400

(NOT USED) TIMECLOCK "BUILDING LIGHTS" A

(NOT USED) TIMECLOCK "DRIVE THRU" B

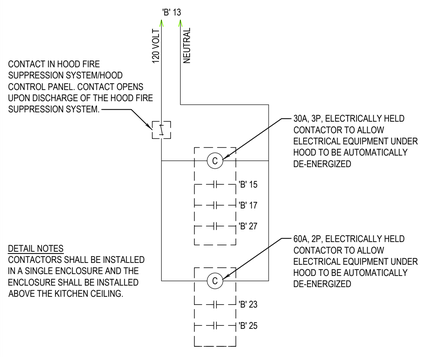

FIRE SUPPRESSION SHUTDOWN 13

NOT TO SCALE E-400

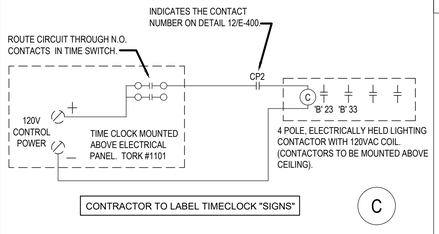

CONTRACTOR TO LABEL TIMECLOCK "SIGNS" C

(NOT USED) TIMECLOCK "PARKING LOT" D

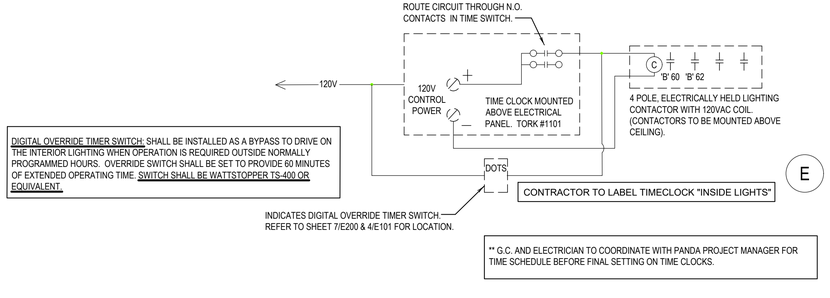

CONTRACTOR TO LABEL TIMECLOCK "INSIDE LIGHTS" E

** G.C. AND ELECTRICIAN TO COORDINATE WITH PANDA PROJECT MANAGER FOR TIME SCHEDULE BEFORE FINAL SETTING ON TIME CLOCKS.

TIME CLOCKS 11

NOT TO SCALE E-400



FREEZER LTG & DOOR HTR WIRING DIAGRAM 10

NOT TO SCALE E-400



CONDENSING UNIT 7

NOT TO SCALE E-400

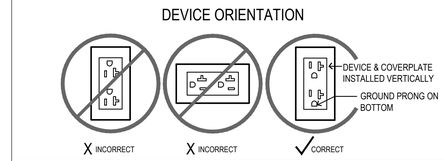

DEVICE & COVERPLATE COLOR

LOCATION	DEVICE COLOR	COVER PLATE COLOR	NOTES
DINING ROOM (WALLS)	VERIFY W/PX	VERIFY W/PX	VERIFY WITH PANDA PM PRIOR TO PURCHASE AND INSTALL
DINING ROOM (IN BULKHEAD ABOVE WINDOWS)	VERIFY W/PX	VERIFY W/PX	VERIFY WITH PANDA PM PRIOR TO PURCHASE AND INSTALL
DINING ROOM (WHEN IN CEILING)	BLACK	BLACK	@ SHOW WINDOW IN DARK CEILING (IF APPLICABLE)
RESTROOM	GREY	STAINLESS STEEL	--
RESTROOM VESTIBULE	GREY	STAINLESS STEEL	--
KITCHEN/SERVICE AREAS	GREY	STAINLESS STEEL	--

DEVICE /RECEPTACLE SCHEDULE 3

NOT TO SCALE E-400

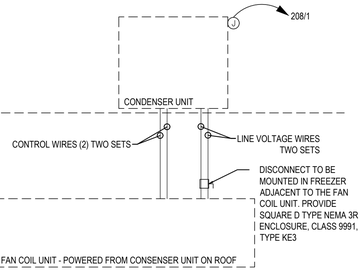

FREEZER EVAPORATOR COIL 9

NOT TO SCALE E-400

1. WIRING SHOULD BE DONE ACCORDING WITH NATIONAL AND LOCAL CODE.
2. CHECK VOLTAGE ON CONDENSING UNIT AND EVAPORATOR COIL BEFORE ANY WORK IS DONE.
3. SOLID LINES TO BE WIRED BY LICENSED ELECTRICIAN ON SITE. DOTTED LINES ARE PRE-WIRED BY THE MANUFACTURER.
4. ANY PENETRATIONS THROUGH BOX SHALL BE SEALED AIR TIGHT.

WIC / WIF WIRING DIAGRAM NOTES 6

NOT TO SCALE E-400



ANSUL PULL STATION DETAIL 2

NOT TO SCALE E-400



COOLER EVAPORATOR COIL 8

NOT TO SCALE E-400



EXHAUST FAN CONTROL DIAGRAM 5

NOT TO SCALE E-400

(NOT USED) PANEL 'A' GRD DETAIL 1

NOT TO SCALE E-400

PANDA EXPRESS, INC.
1683 Walnut Grove Ave.
Rosemead, California
91770
Telephone: 626.799.9898
Facsimile: 626.372.8288

All ideas, designs, arrangement and plans indicated or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.

REVISIONS:

ISSUE DATE:

	LANDLORD REVIEW	03-04-2022
	FINAL LANDLORD REV.	06-20-2022
	PERMIT	07-19-2022
	BID SET	10-06-2022
	CONSTRUCTION SET	01-16-2023

DRAWN BY: G. COLLINS

PANDA PROJECT #: D7861

ARCH PROJECT #: JCDT21-0268

I certify that these documents were prepared or approved by me, and that I am a duly licensed architect/ engineer under the laws of the State of Maryland, license number Sean P. Pick-Kell 52379, expiration date 03-08-2024

NORR ARCHITECTS ENGINEERS PLANNERS

PANDA EXPRESS

TRUE WARM & WELCOME
10300 Mill Run Circle
Owings Mills, MD 21117

E-400

ELECTRICAL DETAILS, DIAGRAMS

CONSTRUCTION SET 01-16-2023

TRUE WARM & WELCOME 2300 R6 RR